


DA7-A100 ISSUE H IF IN DOUBT-ASK
 FIRST W.O.

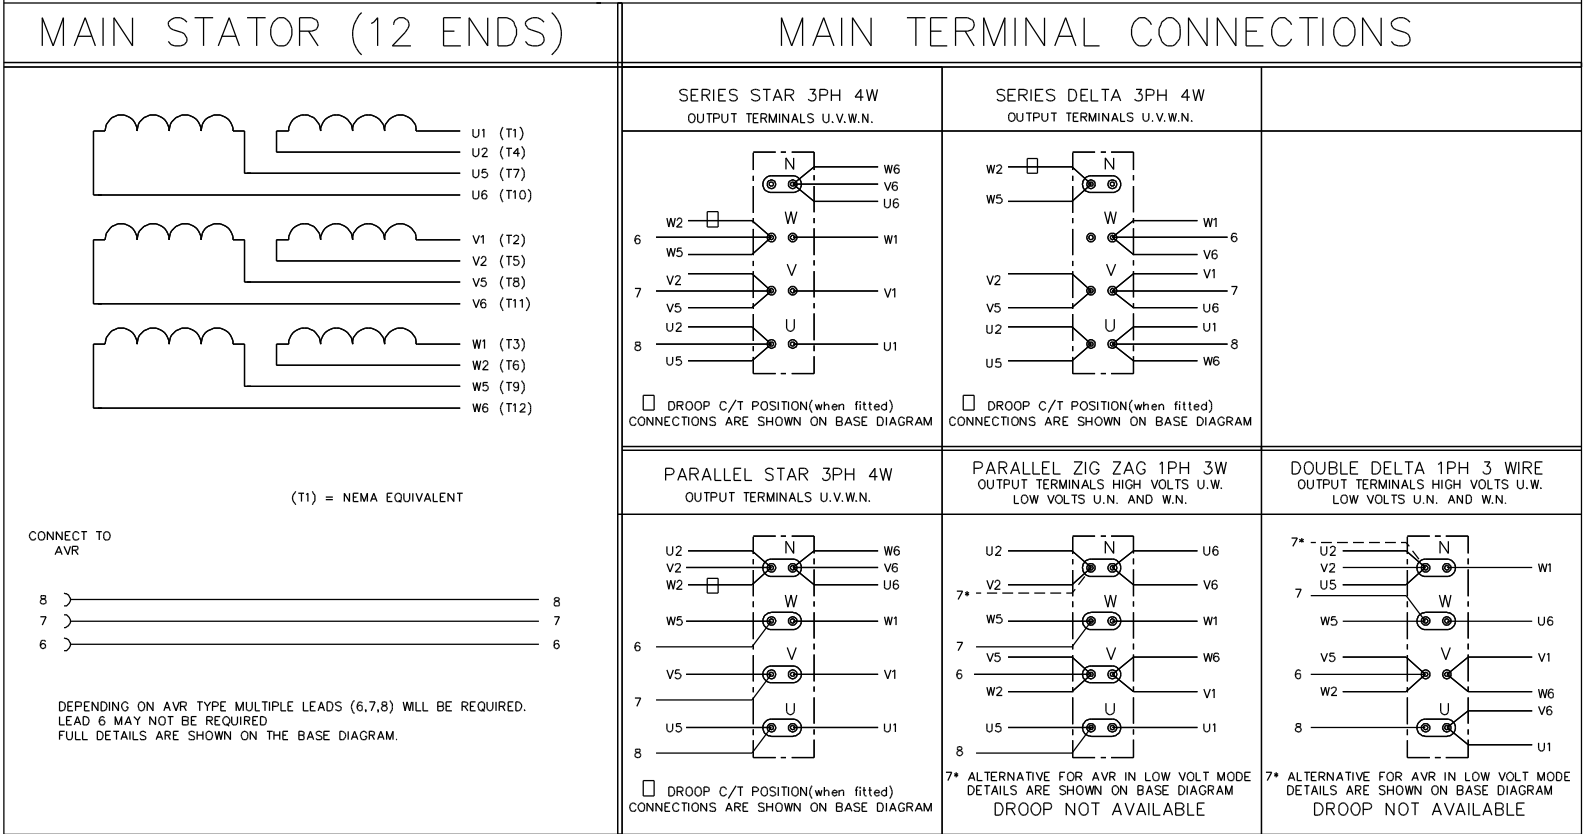

3/9964	H	S.H.	11:4:95	DOUBLE DELTA CONNECTION - CENTRE POINT CHANGED FROM W TO N	<h2 style="margin: 0;">CONNECTION DIAGRAM</h2>			
3/9728	G	S.H.	13:12:94	DOUBLE DELTA CONNECTION BROUGHT IN LINE WITH STATOR LEAD EXIT POSITIONS				
3/9572	F	S.H.	17:10:94	OUTPUT TERMINALS - PARALLEL ZIG ZAG AND DOUBLE DELTA CHANGED	CERTIFIED PRINT	FRAME ---	OTHER FEATURES	
3/9324/1	E	S.H.	4:7:94	DOUBLE DELTA - NOW IN LINE WITH LINK BOARD VERSION	(ONLY IF SIGNED)			
3/8946/2	D	MLW	25.1.94	PARALLEL ZIG ZAG ADDED	BY	CONTROL SERIES ---		
3/8946/1	C	MLW	13.1.94	DOUBLE DELTA CONNECTION ADDED, PARALLEL ZIG ZAG DELETED	DATE	POLES		
3/8428	B	P.N.	17:3:93	DELTA CONNECTION U1 WAS U6 AND U6 WAS U1 ETC	No. OF ENDS	12		
3/8192	A	P.N.	5:1:93	ORIGINAL ISSUE	DRAWN	P.N. 5:1:93	SENSING 2/3 PHASE	
MOD.	ISS.	DRN.	DATE	ALTERATION	CH'D		NEWAGE INTERNATIONAL Ltd	
					APP'D		STAMFORD, ENGLAND	
							DA7-A100	ISSUE H
							SHEET 1 OF 1 SHEETS	